

YC-RL.04.16A.485 4 CH 16A Relay Switch Module

Product Manual

Release : September 22, 2023 Version : V1.4



Figure 1. 4 CH 16A Relay Switch Module




Figure 2. Dimensional Drawing - Front View Figure 3. Dimensional Drawing -Sideview






Figure 4. Product Information



Note: In Fire Mode, the software and manual buttons cannoperate the device.

Figure 5. Fire Interface Description



Product Overview

The 4 CH 16A Relay Switch Module (see Figure 1) serves as a system switch execution unit, typically installed in a distribution box. It can control the switching of lights, the on/off state of devices, the on/off state of passive dry contacts, the opening and closing of strong or weak current curtains, the hot/cold valve of water-cooled air conditioning, and the switching between high/medium/low fan speeds.

Function Description

- Standard 35mm DIN rail installation: Occupies 4P module units
- Equipped with Tyco dual-contact relays, providing 4-channel 16A relay switching.
- Each circuit can independently control devices up to 3520W.
- Supports setting the initial power-on state for each circuit (on, off, or previous power state).
- Features sequential delay startup for multiple circuits to prevent power grid surges from simultaneous startup.
- Includes two interlock modes for controlling two sets of curtains.
- Includes one interlock mode for controlling the low, medium, and high-speed settings of two central air conditioners.
- Returns the actual switch status of each circuit to the monitoring center immediately after executing scene commands.
- Equipped with manual buttons, circuit, and operation status indicators for convenient local maintenance.
- Includes a fire protection interface with one normally open passive and one active 24V connection.
- Supports online firmware updates
- Supports RS485 communication.

Precautions

•

- Use CAT5E or RVV4*0.75 four-core wire for bus wiring.
- After installation, check all connections to ensure they are correctly connected.
- The current for each output circuit must not exceed 16A.
- To protect the equipment and load, it is recommended to connect a 16A circuit breaker for each circuit.

Product Information

Product Dimensions: See Figures 2 and 3

- Product Wiring: See Figure 8 Product Information: See Figure 4
- Relay Output Wiring Terminals: Use a one-in-one-out method; the hole diameter can accommodate 4 square mm wire.
 LED Indicators:
- Power : Power indicator light.
- Bus: Default off in RS485 mode.
- Small Round Light: Circuit selection indicator light. Large Round Light: Relay status indicator light; lit indicates the relay is engaged, off indicates the relay is disconnected.
- 3. Function Keys:

.

- On: Short press to turn on the relay. Off: Short press to turn off the relay.
- All: Select all relays. Select: Select a single relay.
- 4. 485 Bus Interface: 24V, G, A, B.
- 5. Setting Address:
- Step 1: (See Figure 8) Remove the latch cover; it requires some force to pull it out.
- Step 2: (See Figures 6-7) Refer to the address setting dip switch table to set the dip switch to the corresponding address.
- Step 3: After setting the address, remember to replace the latch cover.
- 6. Fire Interface:
- Fire Center: Provides a normally closed signal to engage all 4 circuits; provides a normally open signal to disconnect all 4 circuits, with priority over software and manual control (see Figure 5).

Product Installation

- See Figures 9-12
- Step 1. Secure the 35mm rail with screws.
 - Step 2. Remove the snap-on cover from the 4 CH 16A Relay Switch Module.
 - Step 3. Press the entire module onto the rail and slide it until it is in the correct position, then snap the cover into place.

Safety Warning


- Each relay circuit requires a suitable circuit breaker or fuse.
- Tightening torque should not exceed 0.4 Nm.
- Input power wire: Max 4mm²; Load wire: Max 1mm².
- Installation location: Distribution box.
 - Do not connect the RS485 BUS interface incorrectly, as it may damage the equipment.
 - The RS485 BUS interface must not be connected to AC power; otherwise, it will damage all devices on the bus.
- Ensure a good ventilation environment.
- Do not expose to rain, contact with other liquids, or corrosive gases.

Packing List

•

• YC-RL.04.16A.485*1/User Manual*1/Certificate of Conformity*1

12345678 IDSET			
ID01 ID02 ID03 ID04 ID05 ID06 ID0	7 ID08		
ID09 ID10 ID11 ID12 ID13 ID14 ID1	5 ID16		
ID17 ID18 ID19 ID20 ID21 ID22 ID2	23 ID24		
	17 ID48		
ID49 ID50 ID51 ID52 ID53 ID54 ID5 ID57 ID58 ID59 ID60 ID61 ID62 ID6			
Figure 7. Address Dip Switch Table 2			







Figure 8. Product Wiring Diagram

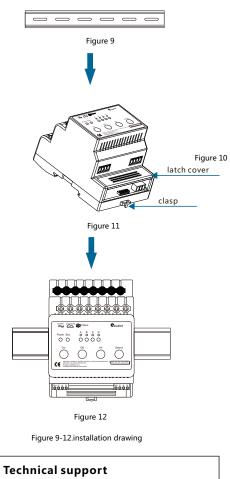

Service Hotline: 86-18029750069

working hours: 9:00-12:00,13:00-18:00,From Monday to Friday)


Email:ceshi@easyctrlgz.com website:http://www.easyctrlgz.com




2025 Guangzhou Easyctrl Intelligent Technology Co., Ltd. All rights reserved This manual may be changed or updated without prior notice.

Technical Parameters

reenneurraraneters	
Basic Parameters	
Operating Voltage	24VDC±10%
Maximum Power Consumption	≤1.3W
Rated Voltage	250/400VAC
Output Circuit	4-channel relay
Relay	Tyco double-contact relay
Rated Current	16A (single channel),Surge current capability: 165A/20ms (single channel)
Switching Cycles	no-load: 5,000,000 cycles , load: 3,000,000 cycles
Protection	circuit breaker for each circuit
External Environment	
Operating Temperature	-5°C~45°C
Operating Relative Humidity	≤90%
Storage Temperature	-20°C~60°C
Storage Relative Humidity	≤93%
Product Specifications	
Dimensions (L*W*H)	72 mm*102 mm*72 mm
Net Weight	≤241 g/pcs
Enclosure Material	flame retardantPP
Installation Method	standard 35mm DIN rail mounting (see Figure 9-12)
Protection Level	IP20
System Diagram	





RVV4*0.75

Bus Specification

-		
Bus interface	4-core wire : RVV4*0.75	UTP : CAT5/CAT5E
24V	RED	BROWN WHITE/BROWN
GND	BLACK	BLUE WHITE/BLUE
А	YELLOW	ORANGE WHITE/GREEN WHITE
В	GREEN	ORANGE/GREEN